

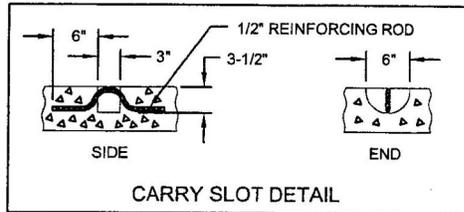
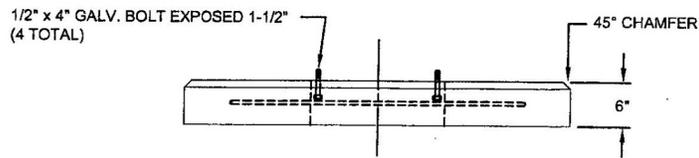


VAULT CONSTRUCTION - UNDERGROUND

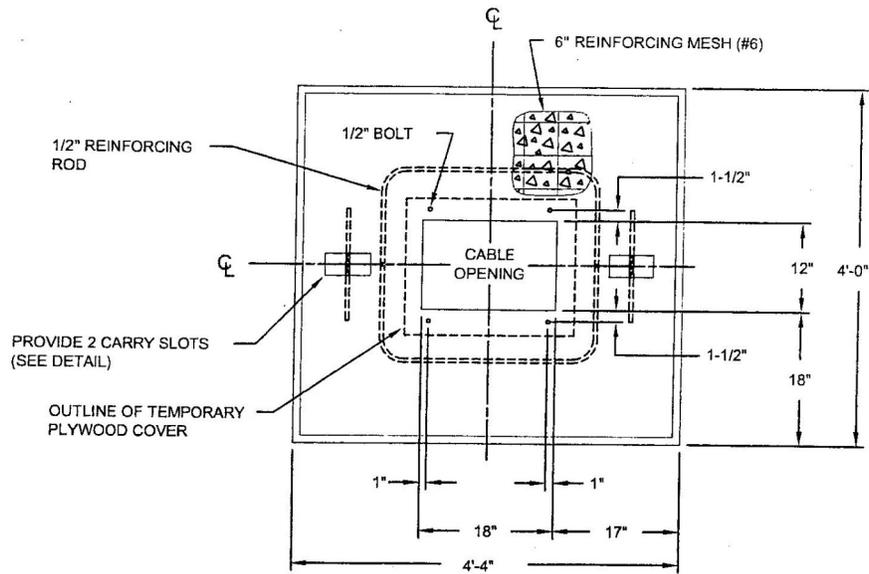

NOTE:

- 1.) CONCRETE SHALL HAVE A COMPRESSIVE STRENGTH OF 5000 P.S.I. AFTER 28 DAYS WHEN TESTED IN ACCORDANCE WITH ASTM C 39-72 (LATEST EDITION).
- 2.) USE WITH VAULT COVER U7-5B.
- 3.) CONTRACTOR SHALL SUPPLY MEANS TO SECURE CABLE OPENING FROM ENTRY.

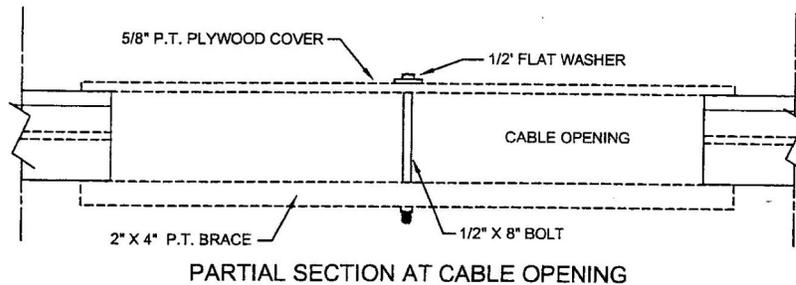

**Wolfeboro Municipal
Electric Department**
569-8157

**SINGLE PHASE SECTIONALIZER
VAULT PAD FOR U5-5
INCLUDING TEMPORARY CABLE OPENING COVER**

VAULT PAD
U6-5B