


INSTALLATION REQUIREMENTS FOR UNDERGROUND CONDUIT

ONE OR MORE SECONDARY CONDUITS WITH TELEPHONE AND / OR CABLE TV

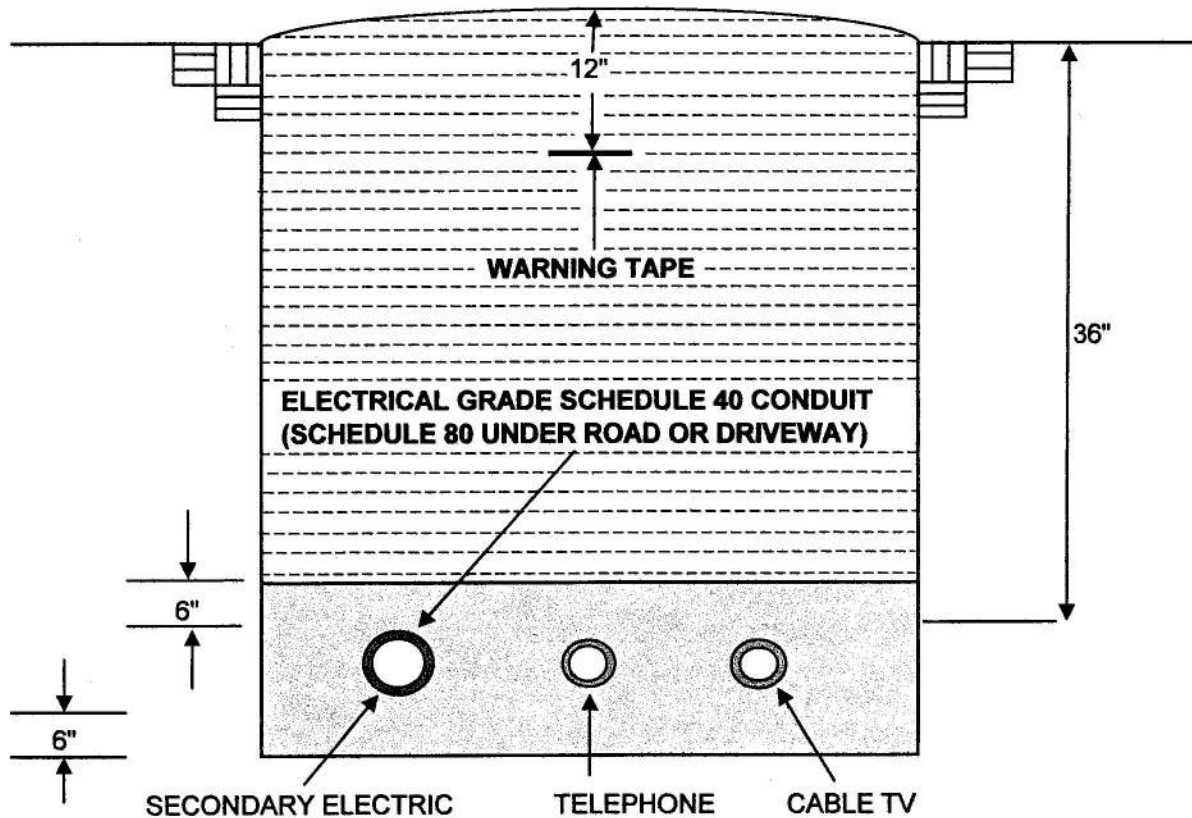

Note:

- * **3" Conduit for 200 Amp services or less, 4" Conduit required for services over 200 Amp**
- * Trench width as required to maintain 6" spacing between all conduits and trench sidewalls.
- * Trenches to be in as straight line as possible, no more than 180 degree radius of sweep per run.
- * Rigid steel sweeps required for all runs over 150 ft.
- * Schedule **80** PVC or rigid required under all roadways and/or driveways.
- * A pulling twine must be installed in each conduit.
- * Conduit requirements for Phone & TV will need to be obtained by each respective utility.

* TRENCH INSPECTION IS REQUIRED BY WOLFEBORO MED PRIOR TO BACKFILLING



COMPACTED BACKFILL
NO ROCKS LARGER THAN
6" DIAMETER



SAND OR FINE BACKFILL
NO ROCKS LARGER THAN
1" DIAMETER



UNDISTURBED EARTH



Wolfeboro Municipal
Electric Department
569-8157

**TRENCH FOR JOINT SECONDARY
ELECTRIC, CABLE TV & TELEPHONE**

TRENCH

UR1-1D